
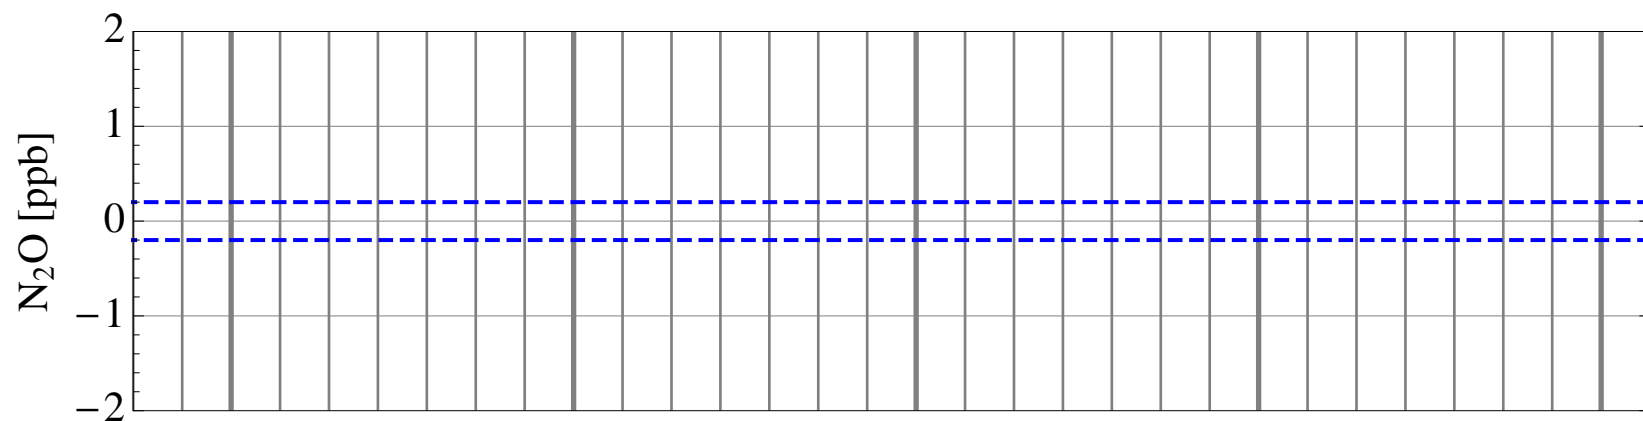
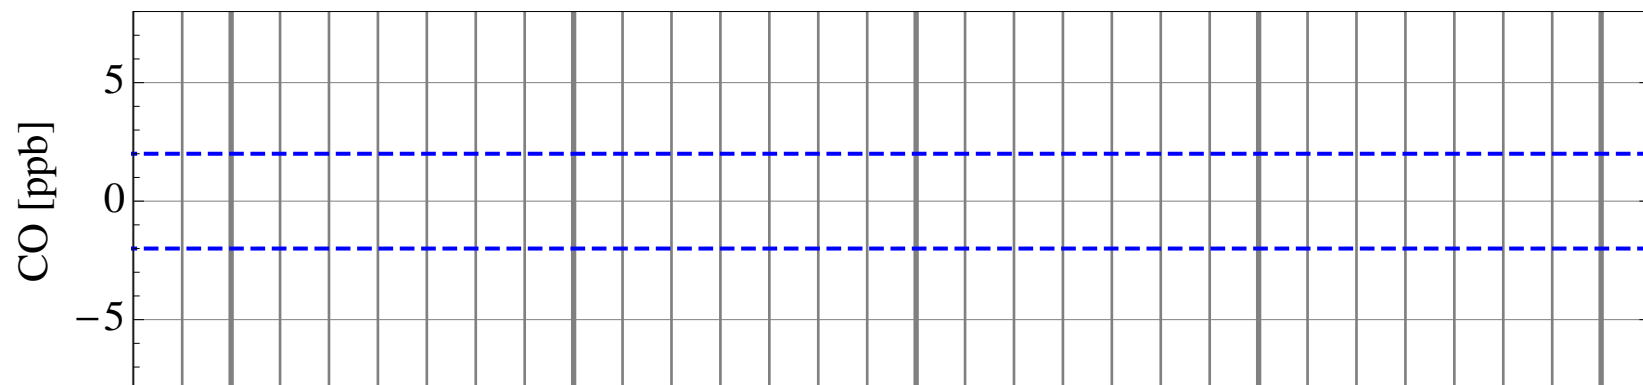
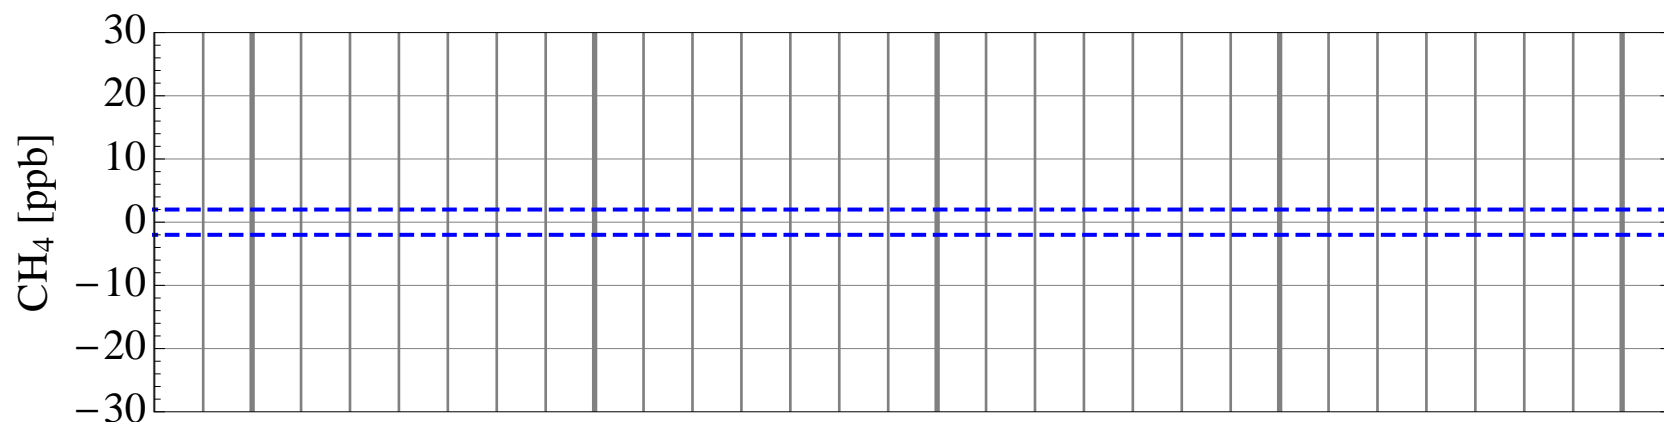
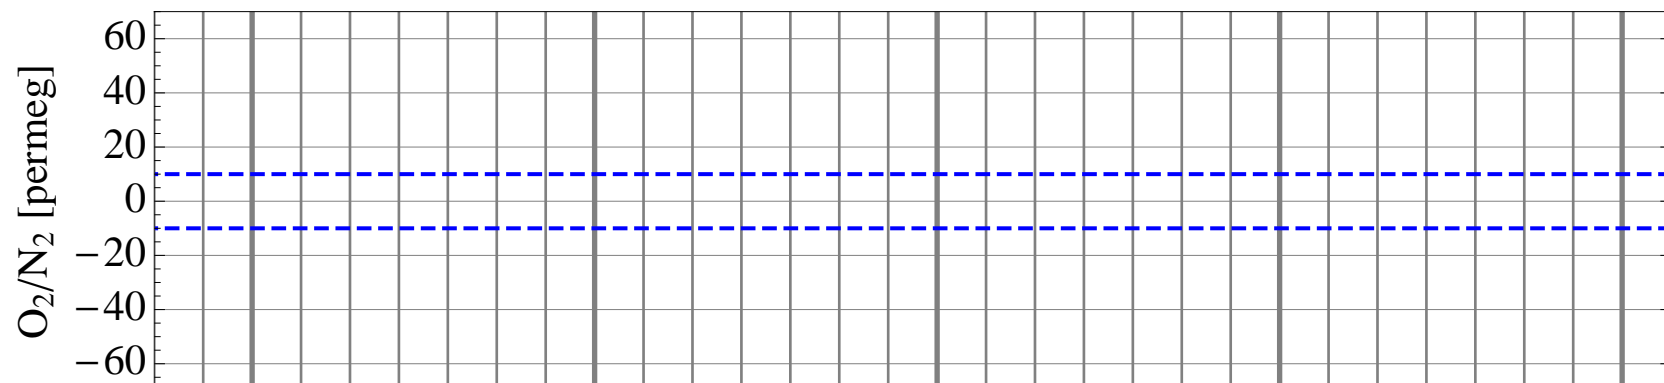


Target Tank Measurements: Accuracy January 2011

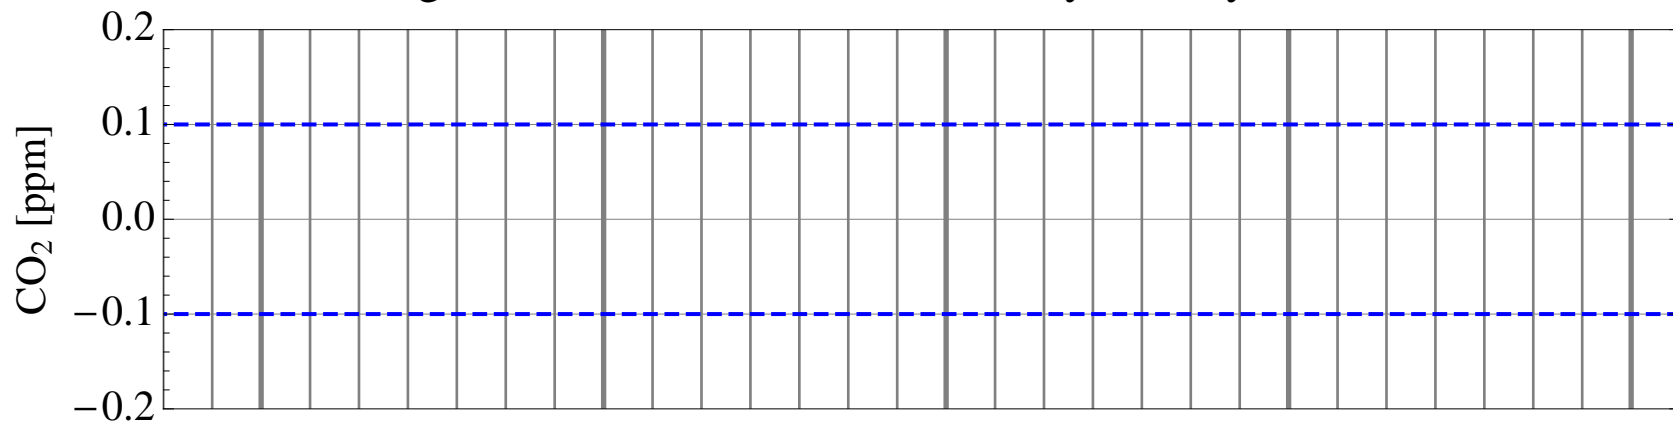

Show[DateListPlot[{}, AspectRatio \rightarrow 0.25, ImagePadding \rightarrow $\left(\begin{smallmatrix} 80 & 30 \\ 20 & 10 \end{smallmatrix}\right)$, ImageSize \rightarrow 700, GridLines \rightarrow $\left\{\begin{array}{l} 3482611200 \text{ AbsoluteThickness[1]} \\ 3482697600 \text{ AbsoluteThickness[1]} \\ 3482784000 \text{ AbsoluteThickness[1]} \\ 3482870400 \text{ AbsoluteThickness[1]} \\ 3482956800 \text{ AbsoluteThickness[1]} \\ 3483043200 \text{ AbsoluteThickness[2]} \\ 3483129600 \text{ AbsoluteThickness[1]} \\ 3483216000 \text{ AbsoluteThickness[1]} \\ 3483302400 \text{ AbsoluteThickness[1]} \\ 3483388800 \text{ AbsoluteThickness[1]} \\ 3483475200 \text{ AbsoluteThickness[1]} \\ 3483561600 \text{ AbsoluteThickness[1]} \\ 3483648000 \text{ AbsoluteThickness[2]} \\ 3483734400 \text{ AbsoluteThickness[1]} \\ 3483820800 \text{ AbsoluteThickness[1]} \end{array}\right.$, Automatic}, DateTicksFormat \rightarrow {Day},